
Operation Manual

Bently Nevada™ Asset Condition Monitoring

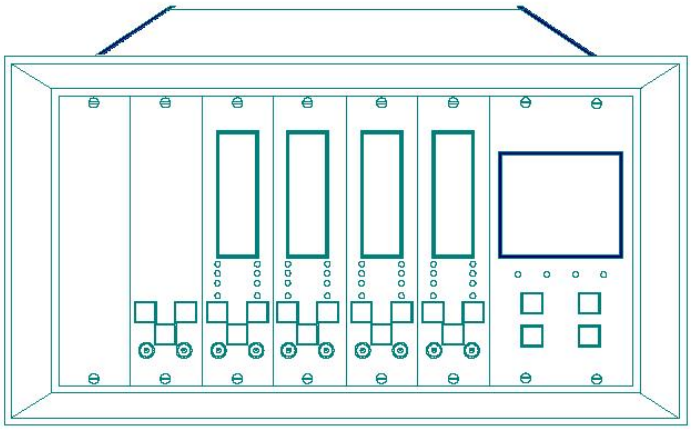

3300/03 System Monitor

imagination at work

Part Number 89604-01
Rev. F (08/07)

2. MONITOR FUNCTIONS

SYSTEM POWER-UP INHIBIT

The System Monitor provides a Power-up Inhibit function. This function allows each monitor to inhibit its alarms during power-up or whenever a system supply voltage falls below its operating level. After power-up, the inhibit function remains active for approximately 2 seconds.

RACK INHIBIT

When activated by a external contact closure this function places all monitors in bypass, disables all alarms, zero scales all outputs, and de-energizes the system OK relay. The connections for this function are located on the power input module (PIM) at the rear of the rack.

SUPPLY VOLTAGES OK

Seven LEDs located behind the front panel of the System Monitor are ON to indicate the voltage supplies are functioning. The voltage supplies are +VRH, +VRL, +7.5V, +5V, REF, -7.5V, and -VT. There is a green LED (SUPPLIES OK) on the front panel of the System Monitor. When this LED is on all of the voltage supplies are functional.

SYSTEM RESET

The System Monitor provides the ability to cause a System Reset. Closing external contacts through terminals on the PIM or pressing the RESET switch on the front panel will cause a System Reset.

TRIP MULTIPLY

The most common use of this function is to prevent unwanted monitor alarms during certain conditions of machine operation. In the operation of some machinery, it is impossible to avoid some periods of "higher than normal" vibration. Examples include startup and coastdown, especially if the operating speed is above rotor system balance resonances ("critical speeds"), structural and other resonances, and changes in machine load or other operating conditions.

The Trip Multiply function causes the monitor alarm setpoints (both Alert and Danger) to increase by a fixed amount, either two times (2X) or three times (3X), according to the ordering option. Only those monitors ordered with this option will be affected. The Trip Multiply function is performed in the System Monitor, but is an ordering option for each monitor. It must be specified at the time of order placement and be installed at the factory.

Trip Multiply is activated by contact closure on the PIM. A red LED on the System Monitor front panel indicates that the Trip Multiply function is active.

OK RELAY

The purpose of this relay is to provide a means to annunciate a problem that is detected with any transducer system connected to the rack. The OK Relay is connected to the OK Circuit of every

monitor in the rack. The OK Circuit continuously checks the condition of the transducer(s) associated with that monitor. If the circuit detects a transducer problem, the OK LED on the front of the affected monitor goes off and a relay drive signal is sent to the OK Relay in the System Monitor.

The OK Relay is located on the System Monitor PIM, is normally energized, and is a single-pole, double-throw (SPDT) relay. Since it is normally energized, the relay also can be used to annunciate when mains power to the rack is lost or interrupted. Either a system power-up inhibit signal from the System Monitor or a not OK signal from any monitor in the rack will cause the OK Relay to change state.

ALARM SETPOINT ADJUST

The System Monitor has two switches on the front panel that adjust alarm setpoint levels on each monitor. One switch is for upscale adjustments, and the other switch is for downscale adjustments.

DATA INTERFACE

The System Monitor supports the following Bently Nevada data interfaces: Dynamic Data Manager (DDM), Transient Data Manager® (TDM), Serial Data Interface (SDI), Dynamic Data Interface (DDI) and Transient Data Interface (TDI). The SDI and DDI are options of the System Monitor and reside within the System Monitor slot of the rack. DDM, TDM and TDI are external data interfaces which gain access to the rack through the PIM. There is an external version of the SDI and DDI which connects to the PIM. For more information about these products consult a Bently Nevada sales representative.

Keyphasor® TRANSDUCERS

The System Monitor receives input from four Keyphasor® transducers through terminals on the PIM. Two of the Keyphasor® transducers are available to the monitors within the rack. All four of the Keyphasor® transducers are available to the Dynamic Data Interface (DDI). Buffered Keyphasor® signals are also available from the coaxial connectors on the front panel. The System Monitor also provides short-circuit protected Keyphasor® transducer power.

STATIC DATA BUS BUFFER

The System Monitor multiplexes signals from either the DDM or TDM to select static data from the monitors. The System Monitor buffers the static data signals sent from the monitor to the DDM or TDM.

6. MONITOR OPTIONS


SYSTEM MONITOR

PART NUMBER

	DATA INTERFACE	AGENCY APPROVAL
3300/03	AXX	BXX
	01 = None or DDM/TDM 02 = SDI 03 = DDI	00 = NOT REQUIRED 01 = CSA 02 = BASEEFA 03 = FM

7. PROGRAMMABLE OPTIONS

The System Monitor has jumper-programmable options for selecting the transducer voltage and the data interface. Change these options by removing and installing jumpers on the circuit board.

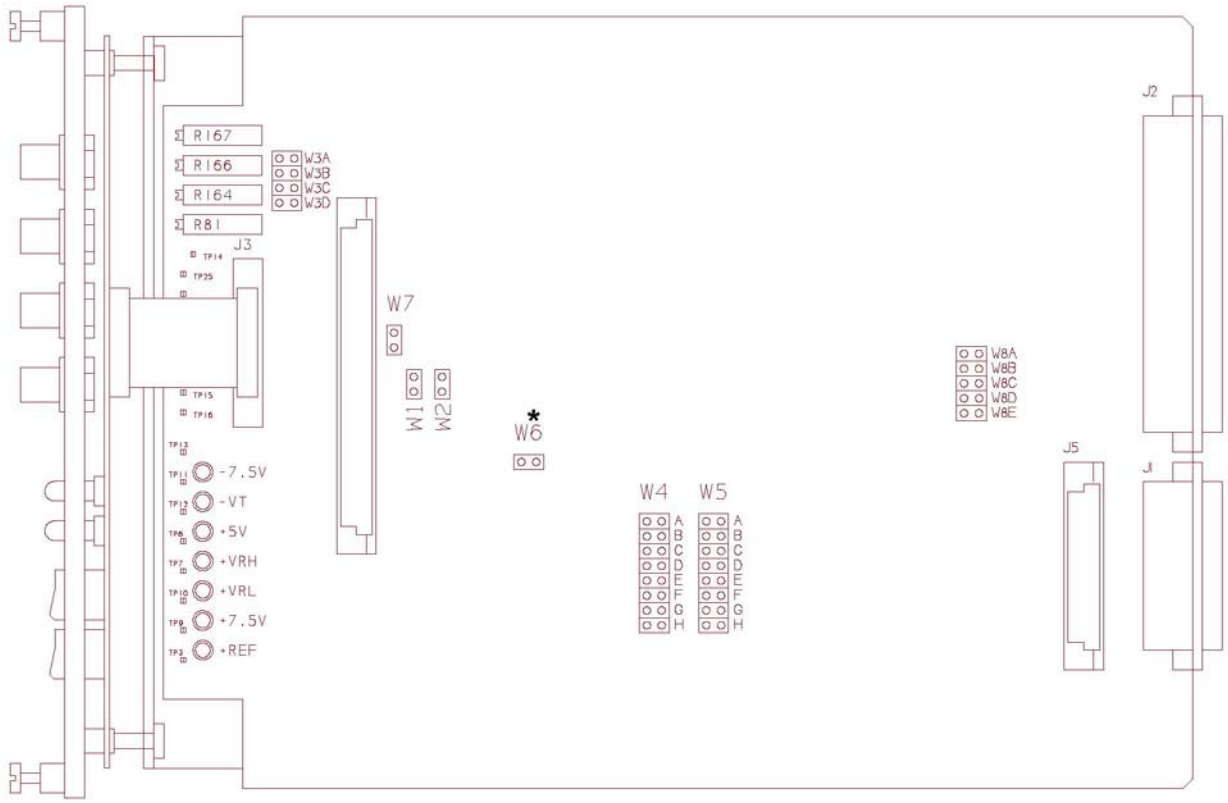

Jumper Locations

* W6 is for future use or is N/A.

Data Manager Options

To configure the System Monitor to work with the different data interfaces remove all option jumpers from headers W3A-W3D, W4A-W4H, W5A-W5H, W7 and W8A-W8E and install jumpers as specified in Table 1.

Table 1. Data Manager Options

OPTION	INSTALL JUMPERS
Dynamic Data Manager® or Transient Data Manager® or No Data Interface	W3A,W3B,W5A,W5B,W5C,W5D,W5E,* W5F,W5G,W5H,W8D & W8E
Internal Serial Data Interface/ Dynamic Data Interface	W3C,W3D,W4A,W4B,W4C,W4D,W4E,** W4F,W4G,W4H,W7,W8D & W8E
External Serial Data Interface/ Dynamic Data Interface or Transient Data Interface	W3C,W3D,W5A,W5B,W5C,W5D,W5F, W5G,W5H,W8A,W8B & W8C

* As shipped from factory for a 3300/03 - 01 System Monitor.

** As shipped from factory for a 3300/03 - 02 or 3300/03 - 03 System Monitor.

-VT Options

To set the -VT option according to the option set on the Power Supply, remove jumpers from headers W1 and W2 and install jumpers as specified in Table 2.


Table 2. -VT Options

OPTION	INSTALL JUMPER	REMOVE JUMPER
-VT = -18 Volts	W2	W1
-VT = -24 Volts	W1	W2

9. OPERATIONAL TESTING

To verify that the system monitor is functional apply power at the Power Input Module. The LED indicating that the supplies are OK should turn on after 2 seconds.

CAUTION
Improper operation may occur. Set -VT Jumpers in the System Monitor and Power Supply to the same voltage (-18 VDC or -24 VDC).

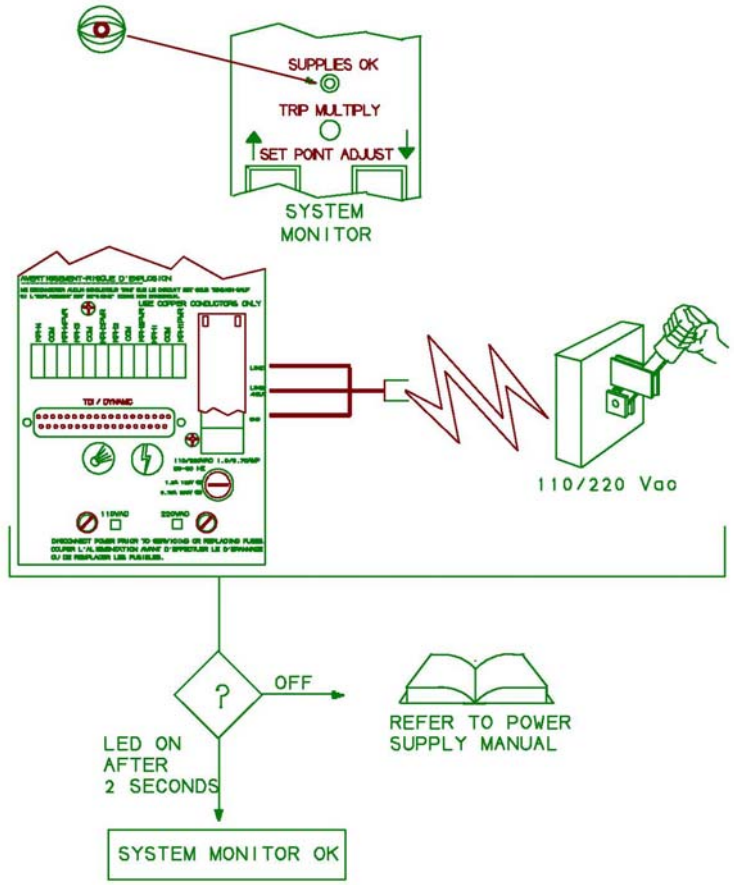


11. RECOMMENDED SPARE PARTS

Table 3. Spare Part Listing

QTY	DESCRIPTION	PART NUMBER
1	Front Panel Assembly 3300/03-01 3300/03-02 3300/03-03	 87900-02* 87900-01* 87900-01*
1	Monitor Circuit Assembly	87890-01*
1	Spare Jumpers (100 pieces)	88706-01

TO ORDER REPLACEMENT PARTS, SPECIFY THE COMPLETE CATALOG NUMBER, 3300/03 – AXX - BXX, AND THE REPLACEMENT PART NUMBER.

If the monitor has been modified, specify the modification number on the parts order. You must set the programmable options. Section 7 lists how the options are set at the factory. If in doubt about the part number, call your Bently Nevada Corporation representative before ordering.

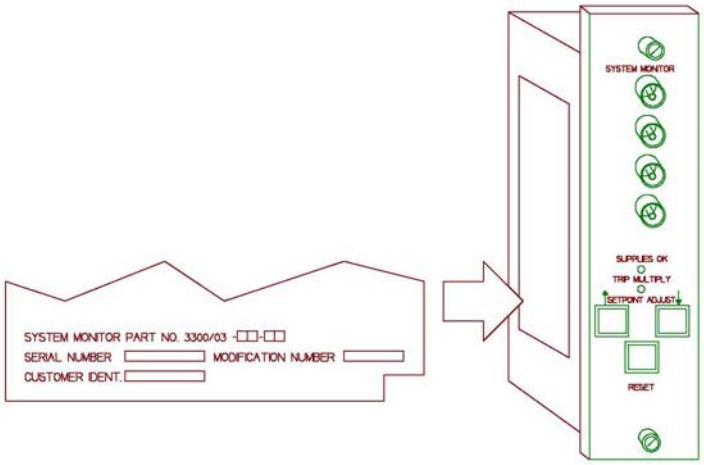

MONITOR IDENTIFICATION LABEL

12. SPECIFICATIONS

INPUTS

No external loads, normal operation mode, 25°C

Supply	Voltage
+VRH:	23.65 ± 6.35 Vdc
+VRL:	11.22 ± 3.09 Vdc
+7.5V:	7.5 ± 0.1 Vdc
+5V:	5.00 ± 0.05 Vdc
REF:	5.00 ± 0.009 Vdc
-7.5V:	-7.5 ± 0.1 Vdc
-VT (-24V Option):	-23.75 ± 0.45 Vdc
-VT (-18V Option):	-17.9 ± 0.4 Vdc

SYSTEM POWER-UP INHIBIT

Delay:	2.1 ± 1 seconds

CONTACT CLOSURE RATING

Contacts for System Reset, Inhibit, OK, and Trip Multiply

Active:	< 100 Ω

Keyphasor®

Output Voltage

-24V Option:	-23.2 V to -24.2 V, Short-circuit Protected
-18V Option:	-17.4 V to -18.3 V, Short-circuit Protected

ENVIRONMENTAL

Temperature:	Operating: +32° F to +149° F (0° C to +65° C).
	Storage: -40° F to +185° F (-40° C to +85° C).
Humidity:	0 to 95%, noncondensing.