


MANUFACTURER-SOURCE TECHNICAL REFERENCE

Allen-Bradley 1756-OV32E

1756-OV32E Evidence-Bounded Product Information Manual

Rockwell Automation ControlLogix 32-point electronically fused sinking digital output module

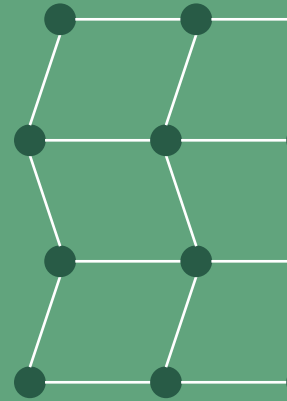

DOCUMENT SCOPE

Independent Apter Power manual compiled only from the cited Rockwell Automation manufacturer sources. No product photograph is included.

Product / lookup identity	Allen-Bradley 1756-OV32E
Reference number	1756-OV32E
Document basis	Published Rockwell Automation product records, PDFs, and manuals listed on page 3



Product page

<https://www.apterpower.com/Allen-Bradley/1756-ov32e>
Apter Power contact

sales13@apterpower.com | +86 180 3023 5313

Workflow and system context

Allen-Bradley 1756-OV32E is an evidence-bounded ControlLogix 32-point electronically fused sinking digital output module. System role: 10 to 30 VDC sinking output, 32 points, 1 A per point; 250 V continuous isolation between groups of 16 outputs Only facts stated by the cited Rockwell Automation material are published; sibling, successor and third-party data are not transferred.

- | | |
|----|---|
| 01 | System Inputs: 10 to 30 VDC sinking output, 32 points, 1 A per point; 250 V continuous isolation between groups of 16 outputs |
| 02 | Processing: Install in an engineered ControlLogix chassis with the correct removable terminal block, field supply, wiring and Logix Designer configuration. |

Published context and boundaries

- | | |
|----|---|
| 01 | Verify the complete Allen-Bradley 1756-OV32E physical label and installed-system documentation before use. |
| 02 | Sourcing and sinking directions are not interchangeable; verify field polarity, load characteristics and electronic-fuse behavior before replacement. |
| 03 | Origin and HS code remain unpublished unless an exact manufacturer record or the physical package label establishes them. |

Verification and release checks

01	Verify the complete Allen-Bradley 1756-OV32E label, revision and installed-system documentation before use.
02	Sourcing and sinking directions are not interchangeable; verify field polarity, load characteristics and electronic-fuse behavior before replacement.
03	De-energize the equipment and follow the site's approved electrical and process-safety procedure before disturbing hardware or wiring.
04	Back up controller, drive, network and configuration data before replacement, migration or firmware work.
05	Verify every companion module, cable, connector, termination and power source from approved drawings.
06	Do not copy electrical, communication, mechanical or lifecycle values from a related model or successor.

Identity and release controls

Verification Status	Verified Exact Catalog Number
---------------------	-------------------------------

Official Rockwell Automation sources

Rockwell Automation 1756-OV32E Product Page	https://www.rockwellautomation.com/en-us/products/details.1756-OV32E.html
ControlLogix Digital I/O Modules User Manual	https://literature.rockwellautomation.com/idc/groups/literature/documents/um/1756-um058_-en-p.pdf