

OM-19 / OM-192S

Analog signal conditioner

OM-19 wiring and setting

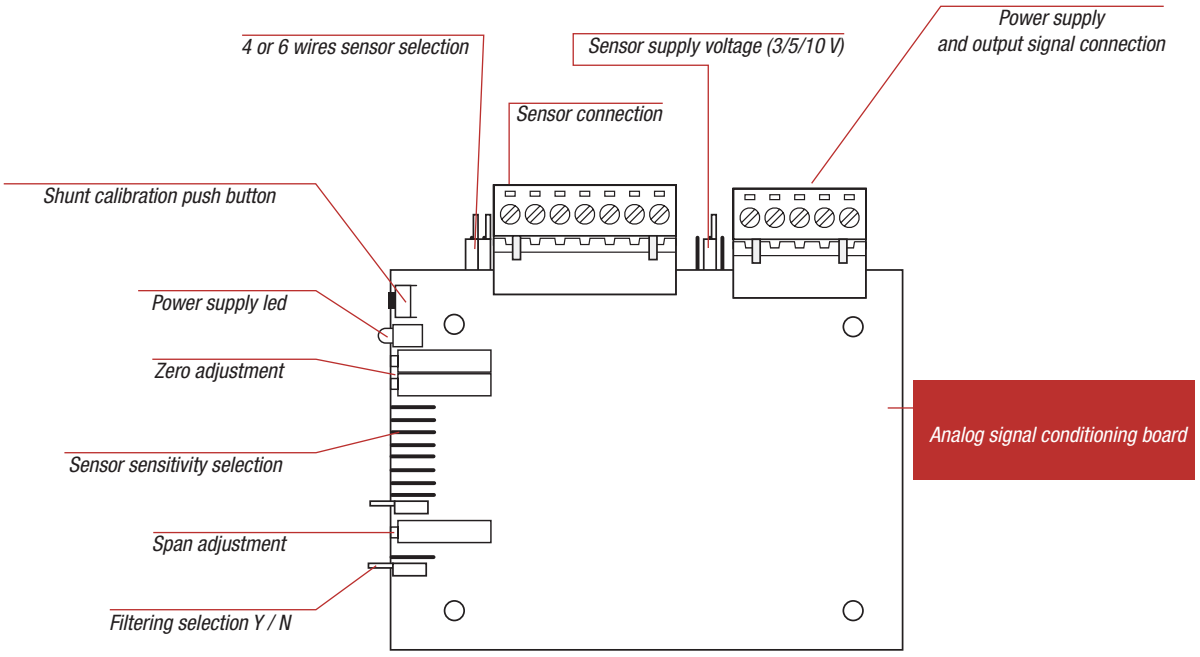

OM-192S wiring and setting

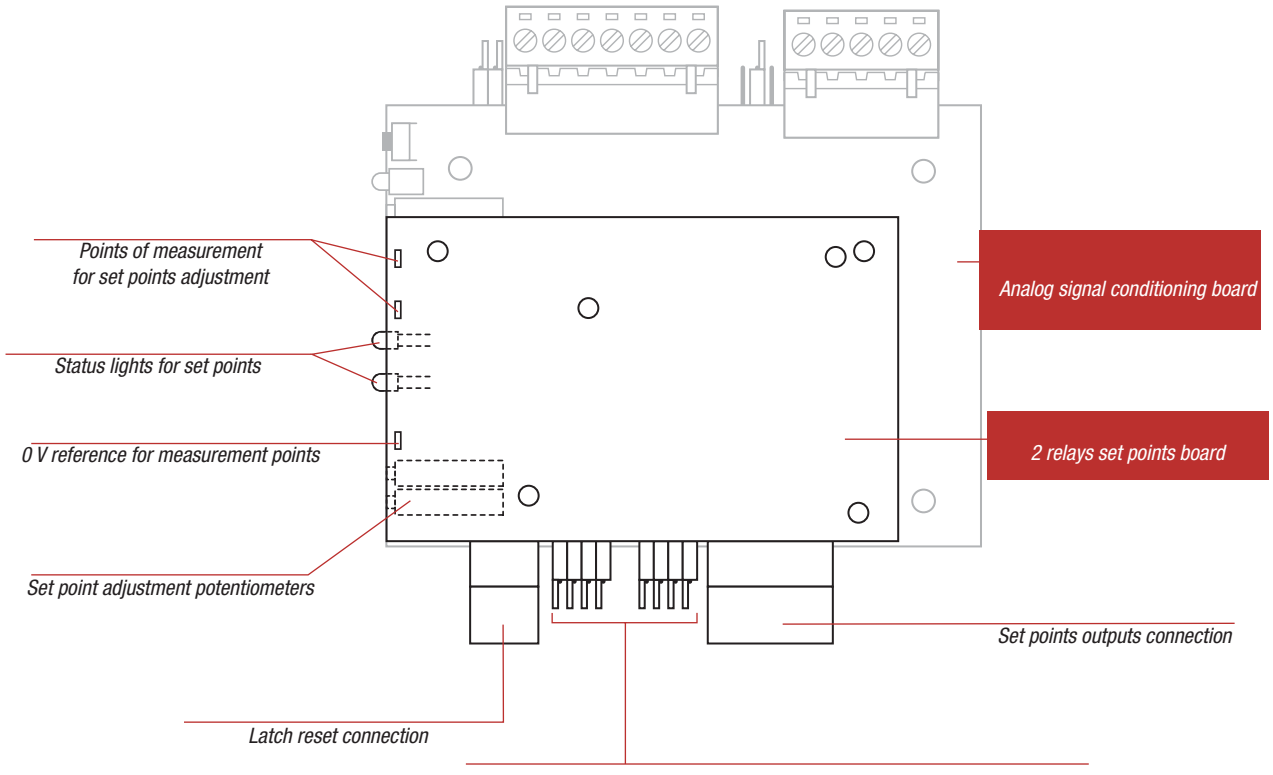

Set points setting:

- *Relay Normally Open / Close*
- *Hysteresis 0.2 / 1.1 %*
- *Relay Holding time 5 / 600 ms*
- *Latch fonction Y / N*